UPS

Uninterruptible Power Supply

564-13133345
www.enersafe.cl

User Manual
ESOL-T-E

On Line, 1kVA a 3kVA

All rights reserved.
The information in this document is subject to change without notice.

Publish statement

Thank you for purchasing this series UPS.
This series UPS is an intelligent, single phase in single phase out, high frequency online UPS designed by our R&D team who is with years of designing experiences on UPS. With excellent electrical performance, perfect intelligent monitoring and network functions, smart appearance, complying with EMC and safety standards, The UPS meets the world’ s advanced level.
Read this manual carefully before installation
This manual provides technical support to the operator of the equipment.

Table of Contents

1. Important Safety Warning 3

1-1 Transportation 3

1-2 Preparation 3

1-3 Installation 3

1-4 Operation 4

1-5 Maintenance, service and faults 4

1-6 Symbols used in this guide 5

2. Installation and setup 5

2-1 Unpack checking 5

2-2 Real panel view 6

2-3 Setup the UPS 7

2-4 UPS start up and turn off 9

3. Operations 13

3-1 Button operation 13

3-2 LCD display 13

3-3 UPS setting 15

3-4 Operational Status and Mode(s) 17

3-5 Alarm or Fault reference code 18

4. Troubleshooting 19

5. Storage and Maintenance 21

6. Options 21

7. Specification 23

1. Important Safety Warning

Important safety instructions – Save these instructions

Please comply with all warnings and operating instructions in this manual strictly. Save this manual properly and read carefully the following instructions before installing the unit. Do not operate this unit before reading through all safety information and operating instructions carefully

There exists dangerous voltage and high temperature inside the UPS. During the installation, operation and maintenance, please abide the local safety instructions and relative laws, otherwise it will result in personnel injury or equipment damage. Safety instructions in this manual act as a supplementary for the local safety instructions. Our company will not assume the liability that caused by disobeyingsafety instructions.

1-1 Transportation

- Please transport the UPS system only in the original package to protect against shock and impact.

1-2 Preparation

- Condensation may occur if the UPS system is moved directly from cold to warm environment. The UPS system must be absolutely dry before being installed. Please allow at least two hours for the UPS system to acclimate the environment.
- Do not install the UPS system near water or in moist environments.
- Do not install the UPS system where it would be exposed to direct sunlight or near heater.
- Do not block ventilation holes in the UPS housing.

1-3 Installation

- Do not connect appliances or devices which would overload the UPS system (e.g. laser printers) to the UPS output sockets.
- Place cables in such a way that no one can step on or trip over them.
- Do not connect domestic appliances such as hair dryers to UPS output sockets.
- The UPS can be operated by any individuals with no previous experience.
- Connect the UPS system only to an earthed shockproof outlet which must be easily accessible and close to the UPS system.
- Please use only VDE-tested, CE-marked mains cable (e.g. the mains cable of your computer) to connect the UPS system to the building wiring outlet (shockproof outlet).
- Please use only VDE-tested, CE-marked power cables to connect the loads to the UPS system.

- When installing the equipment, it should ensure that the sum of the leakage current of the UPS and the connected devices does not exceed 3.5mA.

1-4 Operation

- Do not disconnect the mains cable on the UPS system or the building wiring outlet (shockproof socket outlet) during operations since this would cancel the protective earthing of the UPS system and of all connected loads.
- The UPS system features its own, internal current source (batteries). The UPS output sockets or output terminals block may be electrically live even if the UPS system is not connected to the building wiring outlet.
- In order to fully disconnect the UPS system, first press the OFF/Enter button to disconnect the mains.
- Prevent no fluids or other foreign objects from inside of the UPS system.

1-5 Maintenance, service and faults

- The UPS system operates with hazardous voltages. Repairs may be carried out only by qualified maintenance personnel.
- **Caution** - risk of electric shock. Even after the unit is disconnected from the mains (building wiring outlet), components inside the UPS system are still connected to the battery and electrically live and dangerous.
- Before carrying out any kind of service and/or maintenance, disconnect the batteries and verify that no current is present and no hazardous voltage exists in the terminals of high capability capacitor such as BUS-capacitors.
- Only persons are adequately familiar with batteries and with the required precautionary measures may replace batteries and supervise operations. Unauthorized persons must be kept well away from the batteries.
- **Caution** - risk of electric shock. The battery circuit is not isolated from the input voltage. Hazardous voltages may occur between the battery terminals and the ground. Before touching, please verify that no voltage is present!
- Batteries may cause electric shock and have a high short-circuit current. Please take the precautionary measures specified below and any other measures necessary when working with batteries:

- remove wristwatches, rings and other metal objects

- use only tools with insulated grips and handles.

- When changing batteries, install the same number and same type of batteries.
- Do not attempt to dispose of batteries by burning them. This could cause battery explosion.
- Do not open or destroy batteries. Escaping electrolyte can cause injury to the skin and eyes. It may be toxic.

- Please replace the fuse only with the same type and amperage in order to avoid fire hazards.
- Do not dismantle the UPS system.

1-6 Symbols used in this guide



WARNING!

Riskofelectricshock



CAUTION!

Readthisinformationtoavoidequipmentdamage

2. Installation and setup

NOTE: Before installation, please inspect the unit. Be sure that nothing inside the package is damaged. Please keep the original package in a safe place for future use.

2-1 Unpack checking

- Don’ t lean the UPS when moving it out from the packaging.
- Check the appearance to see if the UPS is damaged or not during the transportation, do not switch on the UPS if any damage found. Please contact the dealer right away.
- Check the accessories according to the packing list and contact the dealer in case of missing parts.

  It includes:

  (1) UPS user's guide

  (2) Software Suite CD


  (3) USB cable

  (4) Power cord (Input and output)


  (5) RS232 cable

2-2 Real panel view


1KVA(S):

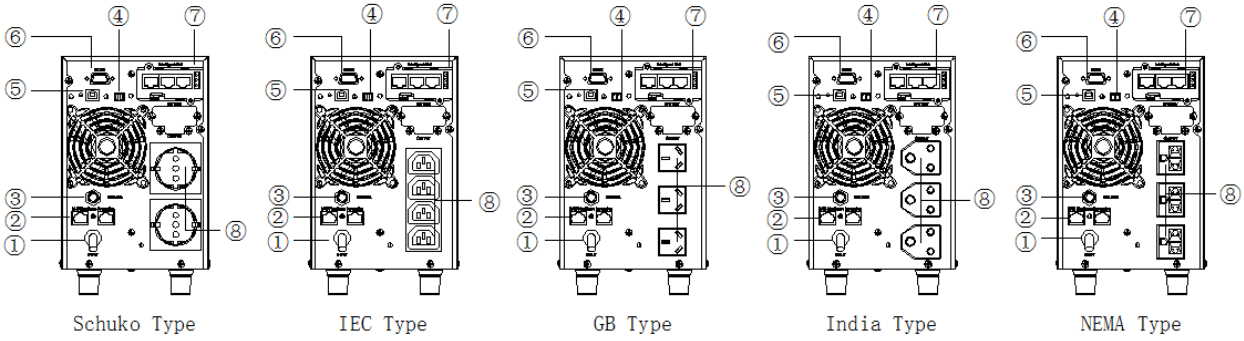


1KVA(H):

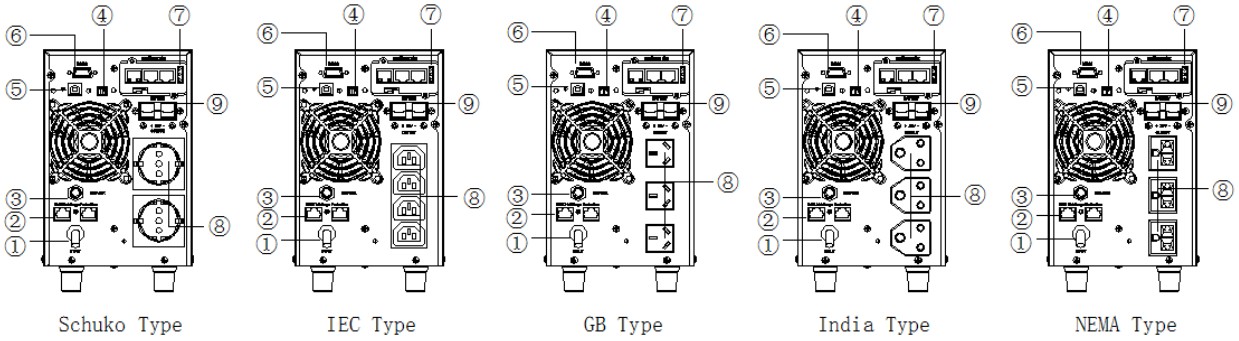


2KVA(S):

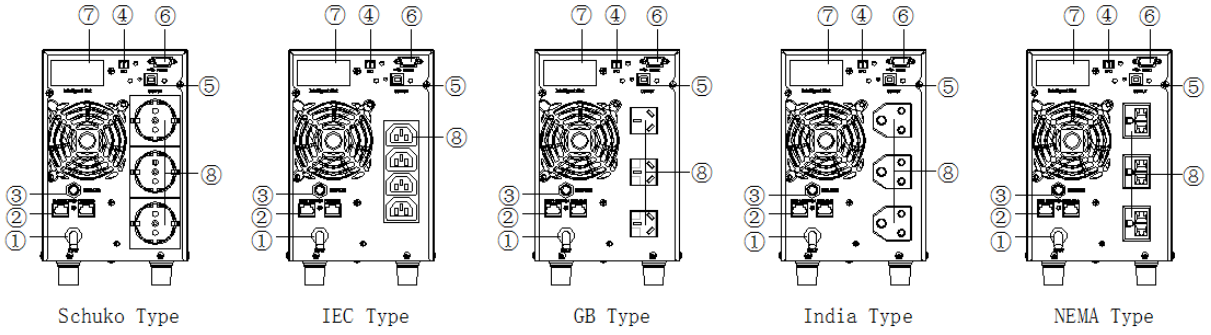


2KVA(H)/3KVA(H)

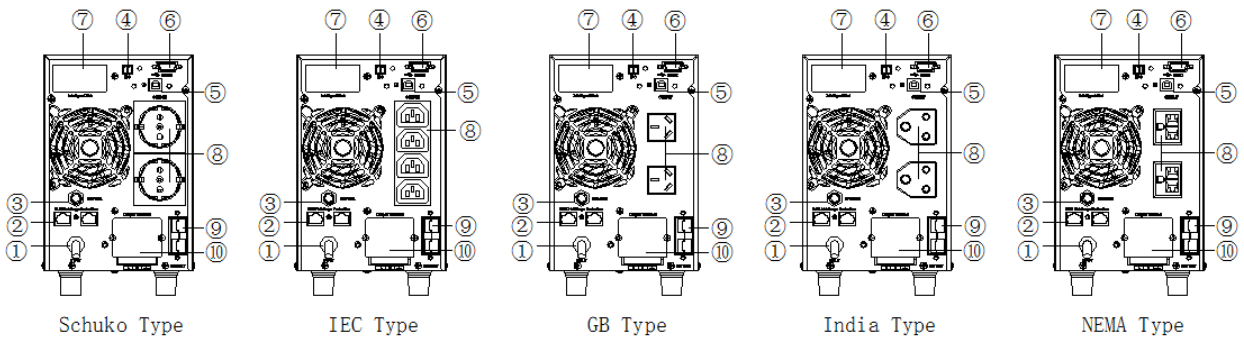


2KVA(S)-6batt /3KVA(S):

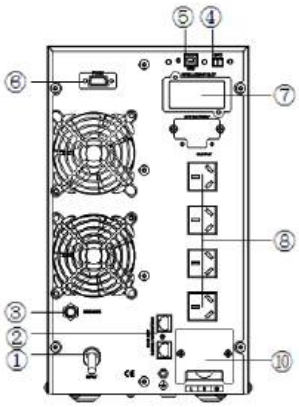


GB Type

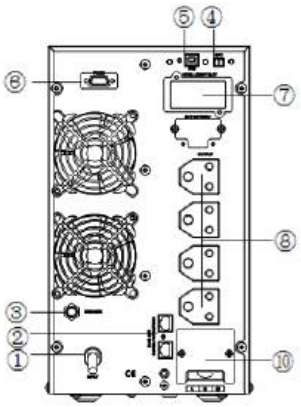


India Type

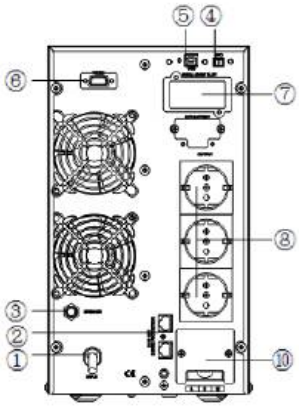

Schuko Type

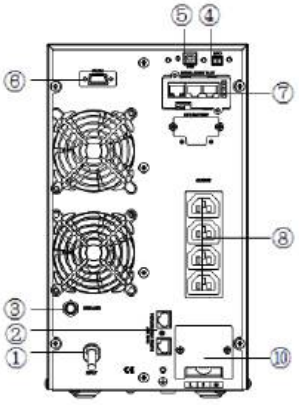

IEC Type

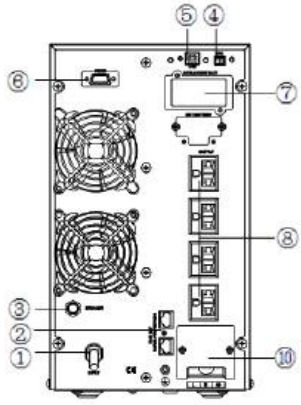

NEMA Type

1. AC input
2. Network /Fax/Modem Surge Protection(option)
3. Input circuit breaker
4. EPO(option)
5. USB communication port(option)
6. RS-232 communication port
7. SNMP intelligent slot (option)
8. Output receptacles
9. Battery Terminal
10. Output Terminal

2-3 Setup the UPS

Step 1: UPS input connection

Plug the UPS into a two-pole, three-wire, grounded receptacle only. Avoid using extension cords.

- For 200/208/220/230/240VAC models: The power cord is supplied in the UPS package.

Step 2: UPS output connection

- For socket-type outputs, simply connect devices to the outlets.
- For terminal-type input or outputs, please follow below steps for the wiring configuration:

  a) Remove the small cover of the terminal block

  b) Suggest using AWG14 or 2.1mm^2 power cords for 3KVA (200/208/220/230/240VAC models).

  c) Upon completion of the wiring configuration, please check whether the wires are securely affixed.

  d) Put the small cover back to the rear panel.

Step 3 Communication connection

Communication port:



To allow for unattended UPS shutdown/start-up and status monitoring, connect the communication cable one end to the USB/RS-232 port and the other to the communication port of your PC. With the monitoring software installed, you can schedule UPS shutdown/start-up and monitor UPS status through PC.

The UPS is equipped with intelligent slot perfect for either SNMP or Relay card. When installing either SNMP or Relay card in the UPS, it will provide advanced communication and monitoring options.

NOTE: USB port and RS-232 port can't work at the same time.

Step 4: Turn on the UPS

Press the ON button on the front panel for two seconds to power on the UPS.


Note: The battery charges fully during the first five hours of normal operation. Do not expect full battery run capability during this initial charge period.

Step 5: Install software

For optimal computer system protection, install UPS monitoring software to fully configure UPS shutdown. You may insert provided CD into CD-ROM to install the monitoring software.

Step 6: External battery connection

If your UPS is not including batteries. Please connect external batteries as below chart.

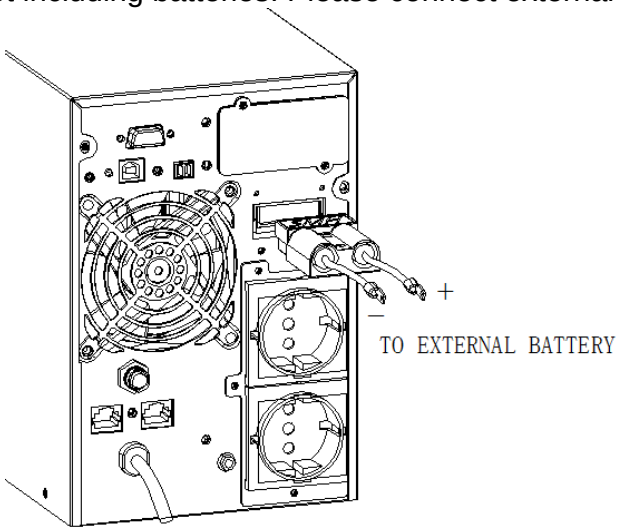

2-4 UPS start up and turn off

● Start up operation

(1) Turn on the UPS in line mode

> ***NOTE*** *Verify that the total equipment ratings do not exceed the UPS capacity to prevent an overload alarm.*

a) Once mains power is plugged in, the UPS will charge the battery, at the moment, the LCD shows that the output voltage is 220, which means the UPS automatic ally tart the inverter. If it is expected to change to bypass model, you can Press "OFF" key.

b) Press and hold the ON key for more than three seconds to start the UPS, then it will start the inverter.

c) Once started, the UPS will perform a self-test function, LED will light and go out circularly and orderly. When the self-test finishes, it will come to line mode, the corresponding LED lights, the UPS is working in line mode.

(2) Turn on the UPS by DC without mains power

a) When mains power is disconnected, press and hold the ON key for more than half a second to start UPS.

b) The operation of the UPS in the process of start is almost the same as that when mains power is in. After finishing the self-test, the corresponding LED lights and the UPS is working in battery mode.

● Turn off operation

(1) Turn off the UPS in line mode

a) Press and hold the OFF key for more than half a second to turn off the UPS and inverter.

b) After the UPS shutdown, the LEDs go out and there is no output. If output is needed, you can set bps "ON" on the LCD setting menu.

(1) Turn off the UPS by DC without mains power


a) Press and hold the OFF key for more than half a second to turn off the UPS.

b) When turning off the UPS, it will do self-testing firstly. The LEDs light and go out circularly and orderly until there is no display on the cover.

Operation and Display Panel

The operation and display panel, shown in below chart, is on the front panel of the inverter. It includes three indicators, four function keys and a LCD display, indicating the operating status and input/output power information.

LCD control panel introduction

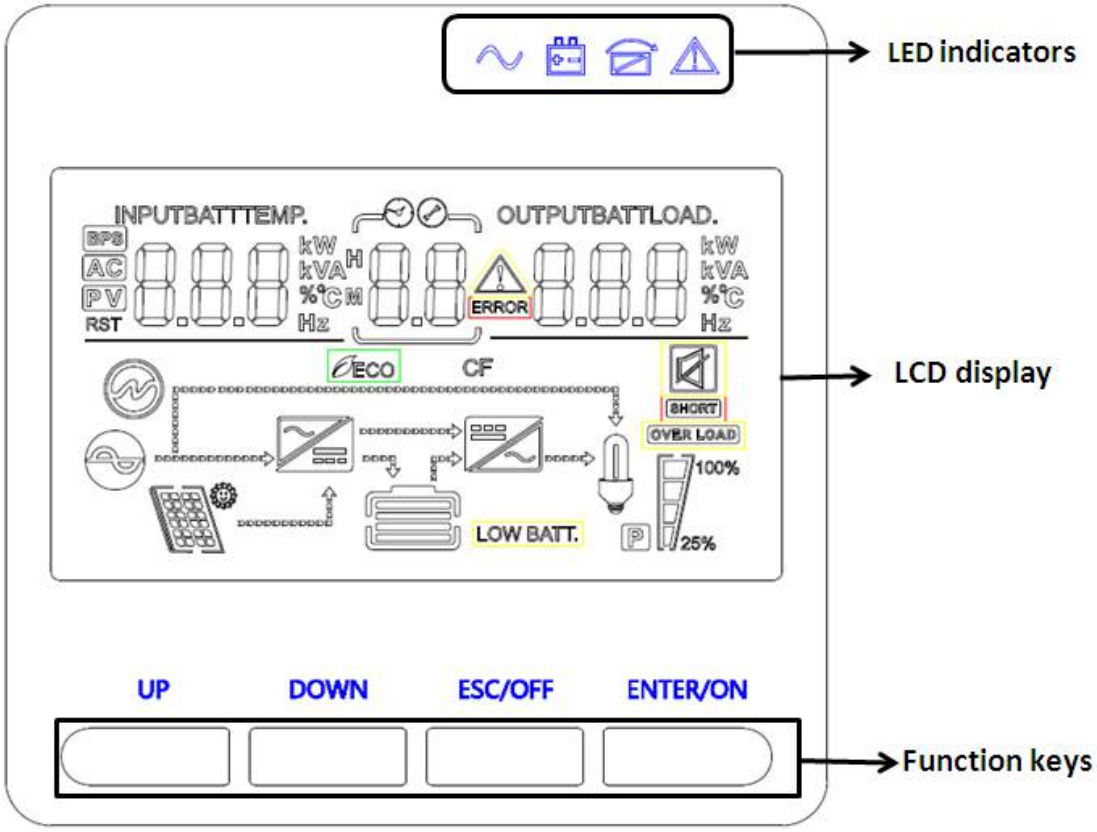

(1) LED (from right to left: "alarm" , "bypass" , "battery" , "inverter");

(2) On-Line UPS LCD display; (3) Function keys


LED Indicator

Indicator	Description
Red	On The UPS has an active alarm or fault.
Yellow	On The UPS is in Bypass mode. The UPS is operating normally on bypass during High Efficiency operation.
Yellow	On The UPS is in Battery mode.
Green	On The UPS is operating normally.
NOTE When power on or startup , these indicators will turn on and off sequentially. ***NOTE*** On different operation modes , these indicators will indicate differently.	

Function Keys

Function Key	Description
ESC/OFF	To exit setting mode Or turn off the ups
UP	To go to previous selection Or turn on the ups
Down	To go to next selection
ENTER/ON	To confirm the selection in setting mode or enter setting mode

LCD Display Icons

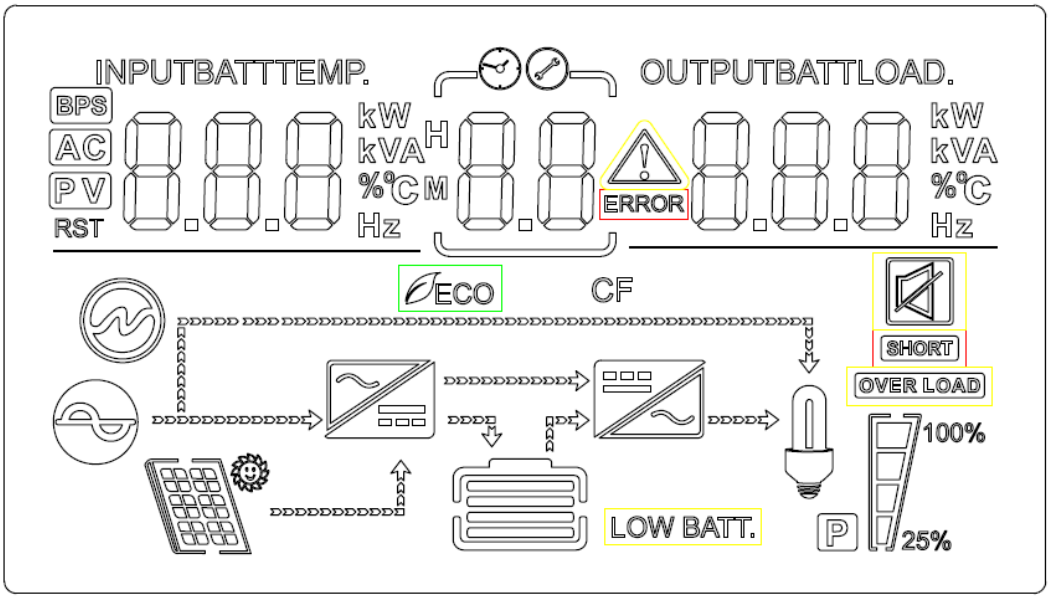


Icon	Function description
Input Source Information	
AC	Indicates the AC input.
INPUTBATT 888 kW VA %°C Hz	Indicate input voltage, input frequency, PV voltage, battery voltage and Temp
Configuration Program and Fault Information	
88	Indicates the setting programs.
88 ERROR	Indicates the warning and fault codes. Warning: 88 flashing with warning code. Fault: 88 ERROR lighting with fault code

Output Information	
	Indicate output voltage, output frequency, load percent, load in VA, load in Watt and discharging current.
Battery Information	
	Indicates battery level by 0-24%, 25-49%, 50-74% and 75-100% in battery mode and charging status in line mode.

In AC mode, it will present battery charging status.

Status	Battery capacity	LCD Display
Constant Curren mode	0-24%	4 bars will flash in turns
	25-49%	Bottom bar will be on and the other three bars will flash in turns
	50-74%	Bottom two bar will be on and the other two bars will flash in turns
	75-100%	Bottom three bar will be on and thetop bars will flash

Load Information				
OVER LOAD	Indicates overload.			
	Indicates the load level by 0-24%, 25-50%, 50-74% and 75-100%.			
	0%~25%	25%~50%	50%~75%	75%~100%
				
Mode Operation Information				
	Indicates unit connects to the mains.			
BYPASS	Indicates load is supplied by utility power.			
	Indicates the utility charger circuit is working.			
	Indicates the DC/AC inverter circuit is working.			
Mute Operation				
	Indicates unit alarm is disabled.			

3. Operations






3-1 Button operation




Button	Function
ON /ENTER Button	➢ Turn on the UPS: Press and hold ON button for at least 2 seconds to turn on the UPS. ➢ Confirm current settings :When the UPS enters the setting mode, must press this button to confirm the settings value what you want,nest press up/down button to change settings information ➢ Out off bypass mode：when the UPS enter to bypass mode, press and hold this button it will switch to normal mode.
OFF /ESC Button	➢ Turn off the UPS: Press and hold this button at least 2 seconds to turn off the UPS in battery mode. UPS will be in standby mode under power normal or transfer to Bypass mode if the Bypass enable setting by pressing this button. ➢ Exit setting mode: Press this button to confirm selection and exit setting mode when LCD display the last selection in UPS setting mode.
UP Button	➢ Up key: Press this button to display previous selection in UPS setting mode.
DOWN Button	➢ Down key: Press this button to display next selection in UPS setting mode.
UP + DOWN Button	➢ Setting mode: Press and hold this button for 5 seconds to enter UPS setting mode.

3-2 LCD display

Part one: Rack display

There are 9 interfaces available in the LCD display.

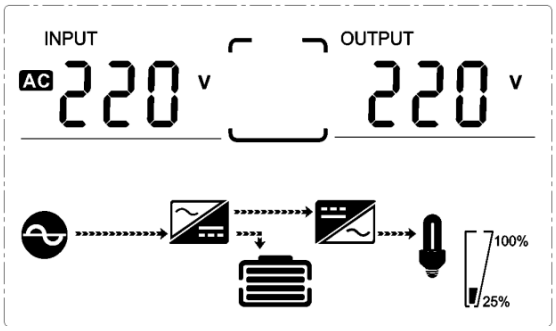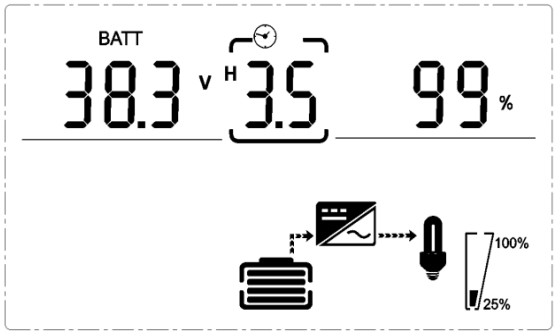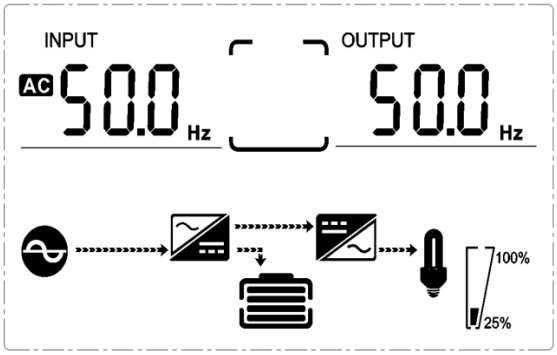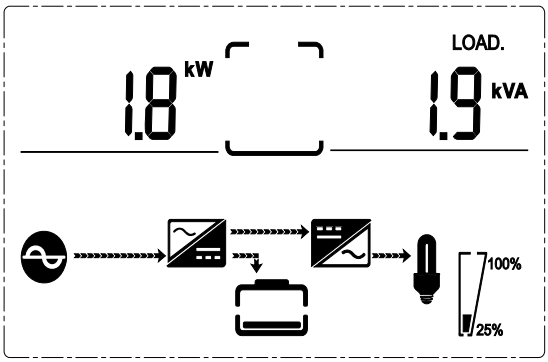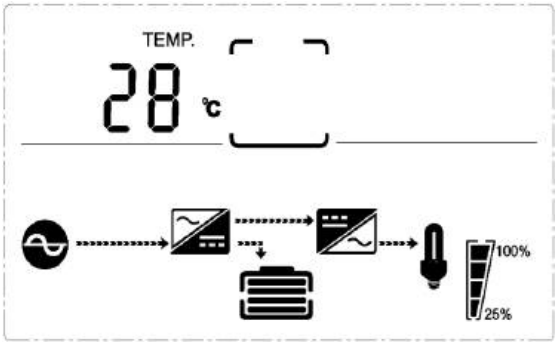Item	Interface Description	Content Displayed
01	Input voltage& Output voltage	
02	Battery voltage& Battery capacity	
03	Input frequency& Output frequency	
04	Load	
05	Environment Temperature	

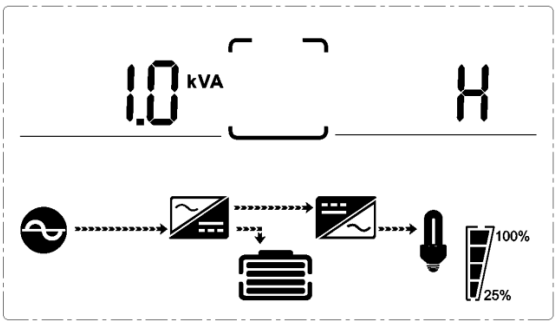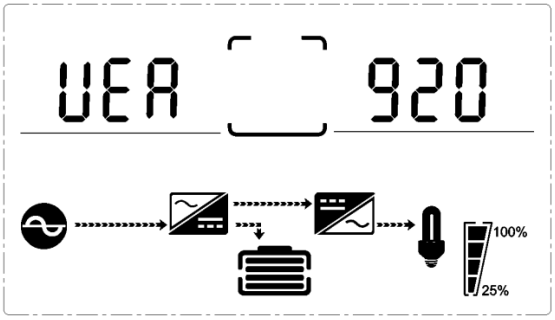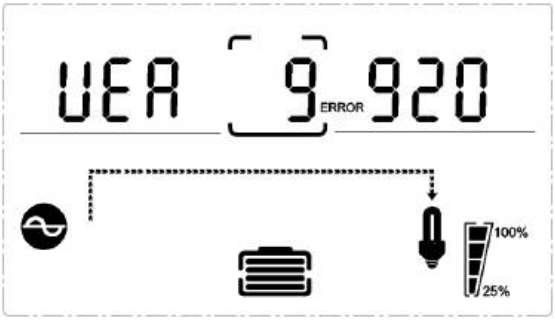06	UPS model.	
07	Firmware Version	
08	Alarm Code(Warming Message) All alarm codes are present when abnormal behavior(s) occur(s)	

3-3 UPS setting

The UPS has setting functions. This user settings can be done under any kind of UPS working mode. The setting will take effect under certain condition. Below table describes how to set the UPS.





The setting function is controlled by 4buttons (Up , Down, ON/Enter,OFF/ESC):

Up ▲+OFF/Down▼---goes into the setting page,

ON/Enter --- - confirm the settings options

Up ▲ & Down ▼--- value adjustment Or for choosing different pages.

After the UPS turn ON, press buttons "▲&▼" for 5 seconds and then goes into the setting interface page.

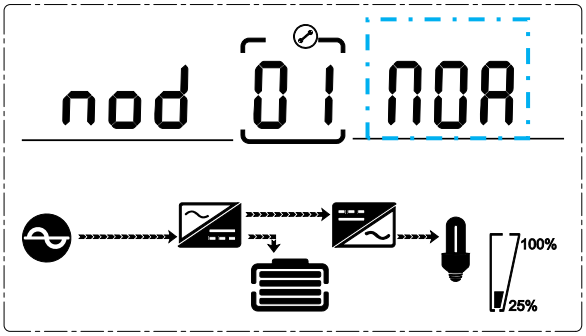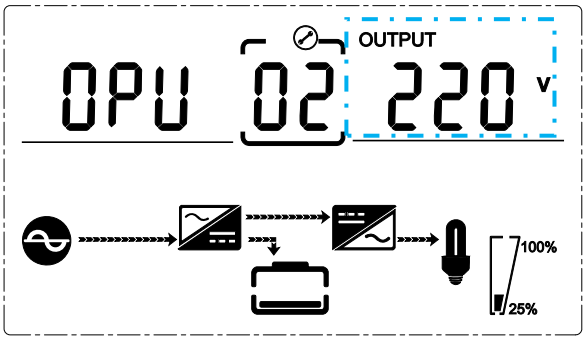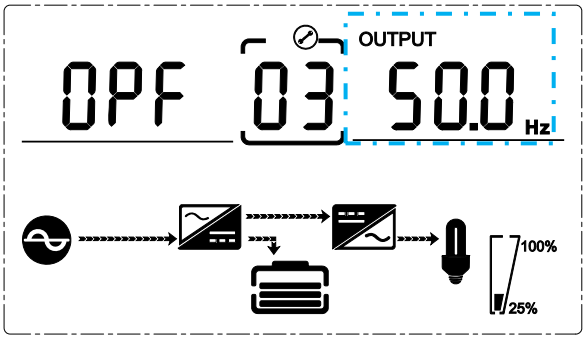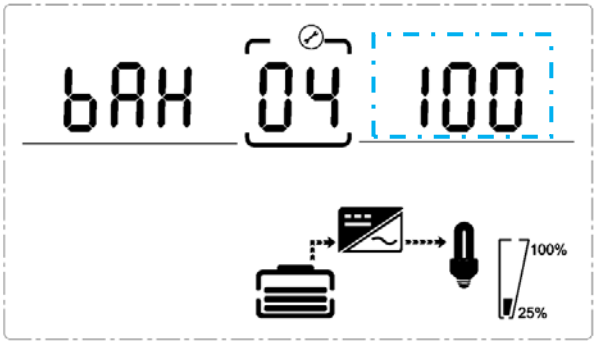Item	Settings	Content display
01	Mode setting Press Enter button to change the setting (ECO or NOR or CF). Press UP ▲button to select the previous setting. Press DOWN▼ button to select the next setting.	
02	Output voltage setting Press Enter button to change the setting(200,208 , 220, 230, 240). Press UP▲ button to select the previous setting. Press DOWN▼ button to select the next setting.	
03	Frequency setting Press Enter button to change the setting (50 or 60Hz). Press UP button▲ to select the previous setting. Press DOWN button ▼ to select the next setting.	
04	Battery capacity setting Press Enter button to change the setting (Battery capacity range is 1-200Ah). Press UP button ▲ to select the previous setting. Press DOWN button ▼ to select the next setting.	
05	Battery EOD voltae setting Press Enter button to change the setting (1.60/1.70/1.75/1.80). Press UP button ▲ to select the previous setting. Press DOWN button ▼ to select the next setting.	

06	Bypass voltage upper limit setting Press Enter button to change the setting(The bypass voltage upper limit range is 230-264Vac). Press UP button ▲ to select the previous setting. Press DOWN button ▼ to select the next setting.	
07	Bypass voltage lower limit setting Press Enter button to change the setting(The bypass voltage lower limit range is 170-220Vac). Press UP button to select the previous setting. Press DOWN button to select the next setting.	
08	Mute setting Press Enter button to change the setting(ON or OFF). Press UP button to select the previous setting. Press DOWN button to save and exit the setup.	
09	BYPASS enable/disable setting Press Enter button to change the setting(ON or OFF). Press UP button ▲ to select the previous setting. Press DOWN button ▼ to save and exit the setup.	

3-4 Operational Status and Mode(s)

item	Content Displayed
1	Initialized
2	Standby Mode
3	No Output
4	Bypass Mode

5	Utility Mode
6	Battery Mode
7	Battery Self-diagnostics
8	Inverter is starting up
9	ECO Mode
10	EPO Mode
11	Maintenance Bypass Mode
12	Fault Mode


3-5 Alarm or Fault reference code

Event log	UPS Alarm Warning	Buzzer	LED
1	Rectifier Fault	Beep continuously	Fault LED lit
2	Inverter fault(Including Inverter bridge is shorted)	Beep continuously	Fault LED lit
9	Fan fault	Beep continuously	Fault LED lit
12	Selftest fault	Beep continuously	Fault LED lit
13	Battery Charger fault	Beep continuously	Fault LED lit
15	DC Bus over voltage	Beep continuously	Fault LED lit
16	DC Bus below voltage	Beep continuously	Fault LED lit
17	DC bus unbalance	Beep continuously	Fault LED lit
18	Soft start failed	Beep continuously	Fault LED lit
19	UPS Inside Over Temperature	Twice per second	Fault LED lit
20	Heatsink Over Temperature	Twice per second	Fault LED lit
26	Battery over voltage	Once per second	Fault LED blinking
29	Output Short-circuit	Once per second	Fault LED blinking
30	Input current limit	Once per second	Fault LED blinking
31	Bypass over current	Once per second	BPS LED blinking
32	Overload	Once per second	INV or BPS LED blinking
33	No battery	Once per second	Battery LED blinking
34	Battery under voltage	Once per second	Battery LED blinking
35	Battery low pre-warning	Once per second	Battery LED blinking
36	Over load time out	Once per 2 seconds	Fault LED blinking
37	DC component over limit.	Once per 2 seconds	INV LED blinking
39	Mains volt. Abnormal	Once per 2 seconds	Battery LED lit
40	Mains freq. abnormal	Once per 2 seconds	Battery LED lit
41	Bypass Not Available		BPS LED blinking

4. Troubleshooting

If the UPS system does not operate correctly, please solve the problem by using the table below and the Trouble Shooting Chart.

Symptom	Possible cause	Remedy
No indication and alarm even though the mains is normal.	The AC input power is not connected well.	Check if input power cord firmly connected to the mains.
	The AC input is connected to the UPS output.	Plug AC input power cord to AC input correctly.
Alarm code is shown as "33" and battery led blinking.	The external or internal battery is incorrectly connected.	Check if all batteries are connected well.
Alarm code is shown as "26" and battery led blinking.	Battery voltage is too high or the charger is fault.	Contact your dealer.
Alarm code is shown as "34" and battery led blinking	Battery voltage is too low or the charger is fault.	Contact your dealer.
Alarm code is shown as "32" and INV or BYPASS led blinking.	UPS is overload	Remove excess loads from UPS output.
Alarm code is shown as "29" and FAULT led light.	The UPS shut down automatically because short circuit occurs on the UPS output.	Check output wiring and if connected devices are in short circuit status.
Alarm code is shown as "9" and FAULT led light.	Fan fault.	Contact your dealer.
Alarm code is shown as "01,02, 15,16,17,18"	A UPS internal fault has occurred.	Contact your dealer.
Battery backup time is shorter than nominal value	Batteries are not fully charged	Charge the batteries for at least 5 hours and then check capacity. If the problem still persists, consult your dealer.
	Batteries defect	Contact your dealer to replace the battery.

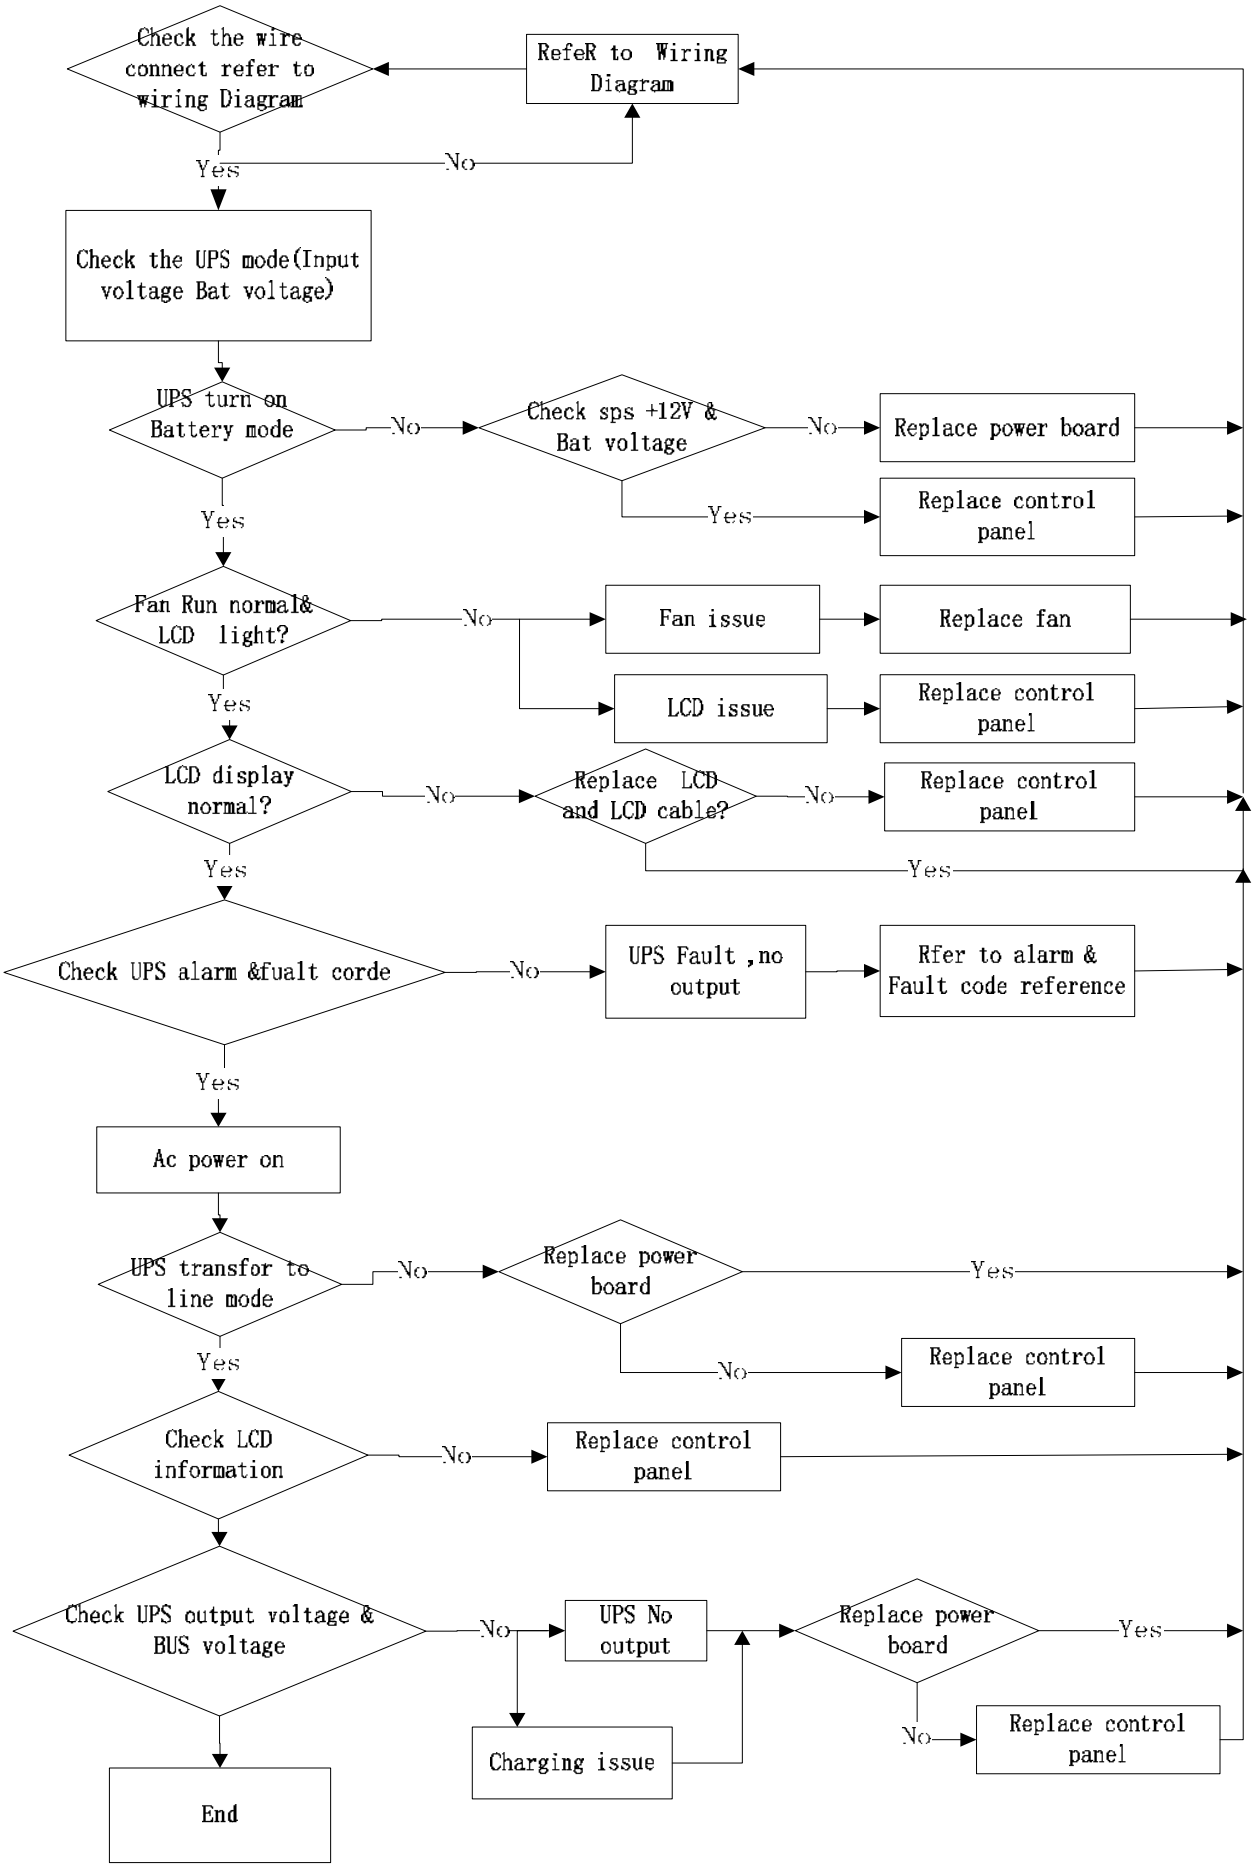

Trouble Shooting Chart

5. Storage and Maintenance

● Operation

The UPS system contains no user-serviceable parts. If the battery service life (3~5 years at 25°C ambient temperature) has been exceeded, the batteries must be replaced. In this case, please contact your dealer.



Be sure to deliver the spent battery to a recycling facility or ship it to your dealer in the replacement battery packing material.

● Storage

Before storing, charge the UPS 5 hours. Store the UPS covered and upright in a cool, dry location. During storage, recharge the battery in accordance with the following table:

Storage Temperature	Recharge Frequency	Charging Duration
-25°C - 40°C	Every 3 months	1-2 hours
40°C - 45°C	Every 2 months	1-2 hours

6. Options

SNMP card: internal SNMP

◆Loosen the 2 torquescrews (on each side of thecard).


◆Carefully insert the SNMP card and lock the screws

The slot called SNMP supports the MEGAtec protocol.We advise that Net AgentII-3 port is also a tool to remotely monitorand manage any UPS system

NetAgentII-3Ports supports the Modem Dial-in(PPP) function to enable the remote control via the internet when the network is unavailable.

In addition to the features of a standard NetAgent Mini,NetAgent II has the option to add Net Feeler Lite to detect temperature,humidity,smoke andsecurity sensors.Thus,making NetAgent II aversatile management tool.NetAgent II also supports multiple languages and is set up for web-based auto languagedetection.



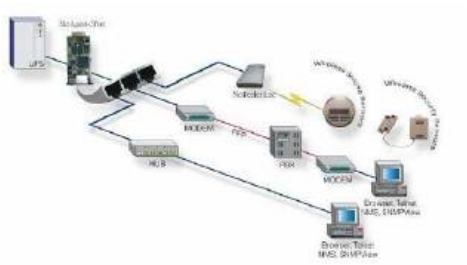

Typical topologyof the UPS NetworkManagement


Relaycard

Mini dry contact card is used foproviding the interface for UPS peripheral monitoring. The contact signals canreflect UPS running status.The card is connected to peripheral monitoring devices via terminal board to facilitate the effective monitoring of the real-timestatus of UPS and timely feedback the statusto monitor when abnormal situation occurs(suchas UPS failure, mains interruption,UPS bypassand ect.). It is installed in the intelligent slotof the UPS.

The relay card includes 6 output ports and one input port.Please refer to thefollowing table for detail.



Product appearance

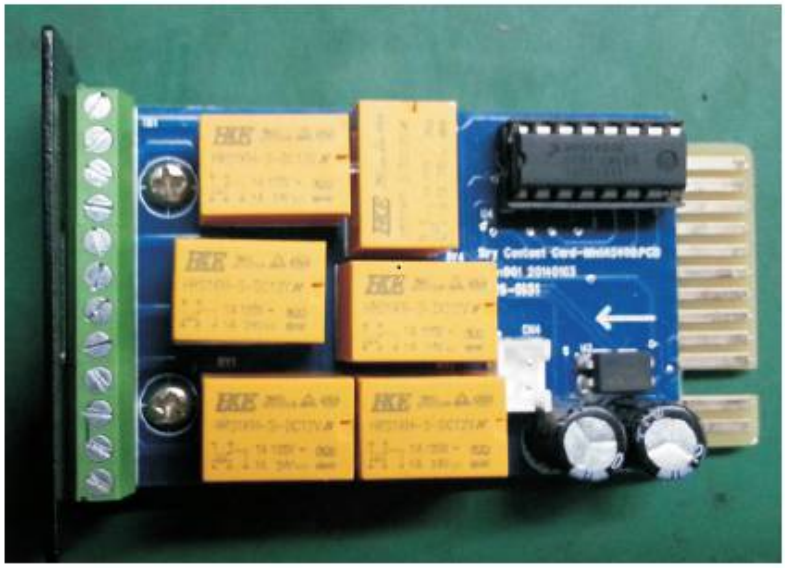

Pins definition of connecting terminal on the board

Terminal No.	Terminal function	Terminal No.	Terminal function
1	Common source	9	Bypass altive NO
2	UPS on NO	10	Bypass altive NC
3	AC fail NO	11	UPS fail NO
4	AC fail NC	12	UPS fail NC
5	Batt low NO	CN4-1	Remote shutdown
6	Batt low NC	CN4-2	GND
7	UPS alarm NO		
8	UPS alarm NC		

7. Specification

MODEL		1KVA(S)	1KVA(H)	2KVA(S)	2KVA(H)	3KVA(S)	3KVA(H)
PHASE		Single phase with ground					
Capacity (VA/Watts)		1000VA / 900W		2000VA / 1800W		3000VA / 2700W	
INPUT							
Nominal voltage		200/208/220/230/240VAC					
Operating voltage range	Low line transfer	160Vac±5% @100%-80% load; 140Vac±5% @80%-70% load; 120Vac±5% @70%-60% load; 110Vac±5% @60%-0% load; (Ambient Temp. <35℃)					
	Low line comeback	175Vac±5% @100%-80% load; 155Vac±5% @80%-70% load; 135Vac±5% @70%-60% load; 125Vac±5% @60%-0% load; (Ambient Temp. <35℃)					
	High line transfer	300Vac ±5%					
	High line comeback	290Vac ±5%					
Operating frequency range		40-70Hz					
Power factor		0.99@100% load(Nominal Input Voltage)					
Bypass voltage range		**Bypass high voltage point** **230-264**: setting the high voltage point in LCD from 230Vac to 264Vac. (Default: 264Vac) **Bypass low voltage point** **170-220**: setting the low voltage point in LCD from 170Vac to 220Vac. (Default: 170Vac)					
Generator input		Support					
OUTPUT							
Output voltage		200/208/220/230/240Vac					
Power factor		**0.9**					
Voltage regulation		±1%					
Frequency	Line Mode (synchronized range)	47-53Hz or 57-63Hz					
	Bat. Mode	**(50/60±0.1)Hz**					
Crest factor		3:1					
Harmonic distortion (THDv)		≤2% THDwith linear load ≤4% THD with non linear load					
Waveform		Pure Sinewave					
Transfer time	AC mode <->Batt. mode	Zero					
	Inverter <-> bypass	4ms(Typical)					
Efficiency	Line mode	88%		92%		92%	
	Batt mode	85%	86%	85%	86%	87%	88%	87%	88%	89%	90%	89%	90%
BATTERY							
Battery Type		12V9AH	depends on the capacity of external batteries	12V9AH	depends on the capacity of external batteries	12V9AH	depends on the capacity of external batteries

Numbers	2	3	2	3	4	6	4	6	6	8	6	8
Backup time	Long run unit depends on the capacity of external batteries											
Typical recharge time(standard modle)	4 hours recover to 90% capacity (Typical)											
Charging voltage	27.4 VDC ±1%	41.0 VDC ±1%	27.4 VDC ±1%	41.0 VDC ±1%	54.7 VDC ±1%	82.1 VDC ±1%	54.7 VDC ±1%	82.1 VDC ±1%	82.1 VDC ±1%	109.4 VDC ±1%	82.1 VDC ±1%	109.4 VDC ±1%
Charge current	1A		12A max, can be setting by LCD		1A		12A max, can be setting by LCD		1A		12A max, can be setting by LCD	
SYSTEM FEATURES												
Overload @35℃	Line Mode Battery Mode	**Ambient Temp.<35℃** 105%~110%: UPS transfer to bypass after 10minuteswhen the utility is normal 110%~130%: UPS transfer to bypass after 1minute when the utility is normal 130%~150%: UPS transfer to bypass after 5 seconds when the utility is normal >150%: UPS transfer to bypass immediately when the utility is normal **35℃<Ambient Temp.<40℃** 105%~110%: UPS transfer to bypass after 1minute when the utility is normal 110%~130%: UPS transfer to bypass after 5 seconds when the utility is normal >130%: UPS transfer to bypass immediately when the utility is normal											
Short Circuit	Hold Whole System											
Overheat	Line Mode: Switch to Bypass; Backup Mode: Shut down UPS immediately											
Low battery voltage	Alarm and Switch off											
EPO (optional)	Shut down UPS immediately											
Audible & Visual alarms	Line Failure, Battery Low, Overload, System Fault											
Comunication interface	USB(or RS232), SNMPcard(optional), Relay card (optional)											
ENVIRONMENTAL												
Operating temperature	0℃～40℃											
Storage temperature	-25℃～55℃											
Humidity range	20-90 % RH @ 0- 40°C (non-condensing)											
Altitude	< 1500m											
Noise level	Less than 50dBA at 1 Meter											
PHYSICAL												
Dimension W×H×D (mm)	144* 209* 293	144* 209* 399	144* 209* 293	144* 209* 293	144* 209* 399	191* 337* 460	144* 209* 399	144* 209* 399	191* 337* 460	191* 337* 460	144* 209* 399	144* 209* 399
Net Weight (kg)	9.8	14.4	4	4.1	17	27.1	6.7	6.8	27.6	32.8	7.3	7.4
STANDARDS												
Safety	IEC/EN62040-1,IEC/EN60950-1											
EMC	IEC/EN62040-2,IEC61000-4-2,IEC61000-4-3,IEC61000-4-4, IEC61000-4-5,IEC61000-4-6,IEC61000-4-8											

* Derate to 80% of capacity when the output voltage is adjusted to 200/208VAC
** Product specifications are subject to change without further notice.